

CENTRO DI RICERCA E SPERIMENTAZIONE
PER L'INDUSTRIA CERAMICA

Requested by:	NICOS International S.p.A. Via Bastie 44 - Zona Industriale 31040 Portobuffolè (TV)		
For the sample:	Portion of shower tray 50 x 100 x 4.0 cm, marked "MINERALSOLID PIETRA shower tray (sabb mold + cleaning with descaler)".		
On (date): 09/10/19	Date of receipt in laboratory (sample delivered by the client):		17/10/19
Sampling details - Where: ----- - Date: ----- By whom: CUSTOMER - How (methods): -----			
Tested in: Bologna	Date of starting: 17/10/19	Date of ending: 17/10/19	

DIN 51097:1992

Determination of anti – slip properties. Wet-loaded barefoot areas – Walking method – Ramp test

OPERATIVE CONDITIONS:

Size of the tested surface (m): 0,50 x1,00

Fixing scheme

See attachment

RESULTS

Average slip angle: >24

CLASSIFICATION (BGI/GUV-I 8527 - 2010)

Application range: A+B+C


Pietro Bruzzi
Technical verification




Prof.ssa Maria Chiara Bignozzi

Director


The results reported relate only to the samples tested. No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision. The reproduction of this test report is only authorized in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction. This test report consists of 1 page and 1 attachment.

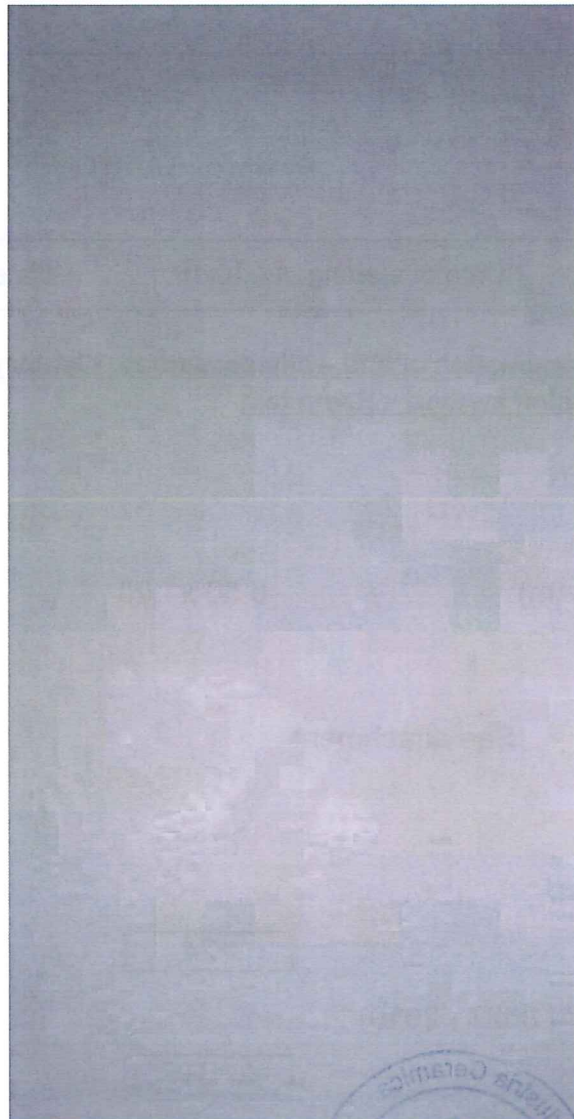

walking
direction

